


Installation guide

Thermostat

Types RT 14E, RT 101E, RT 107E, RT 123E

017R9518

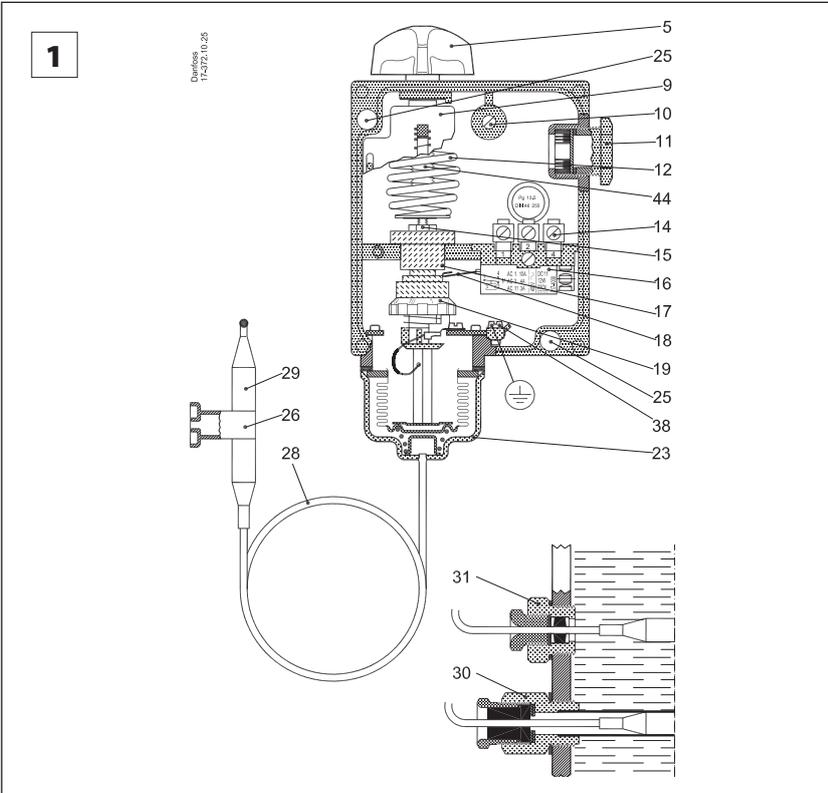


List of applicable standards:

for ATEX: EN 60079-0:2012; EN 60079-11:2012
for IECEx: IEC 60079-0:2011; IEC 60070-11:2011


017R9518

2


RT 14E

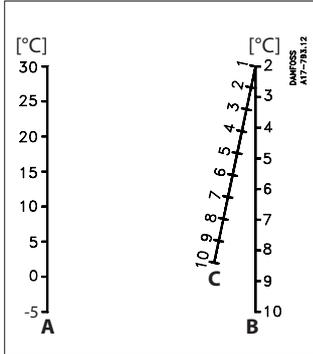


RT 101E

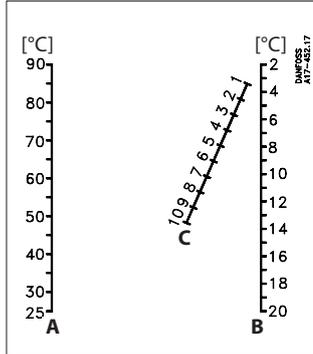

RT 107E

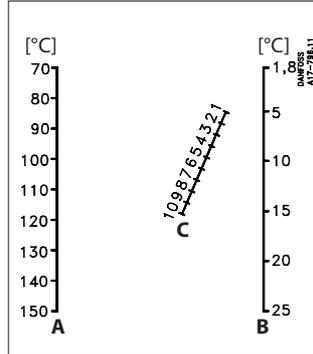


RT 123E

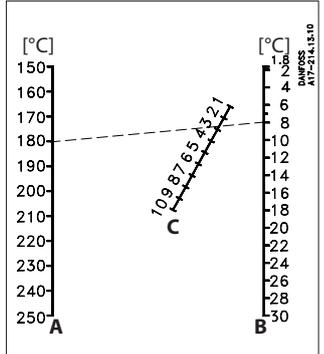


A: Range setting
B: Differential obtained
C: Differential setting

3

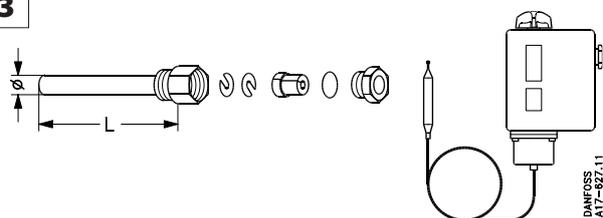

4

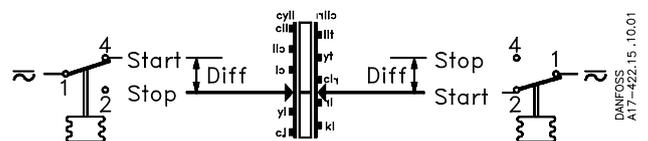

Product marking		Technical data																							
		<table border="1"> <thead> <tr> <th>Type</th> <th>Range [°C]</th> <th>Max. permissible bulb temperature [°C]</th> </tr> </thead> <tbody> <tr> <td>RT 14E</td> <td>-5 – 30</td> <td>150</td> </tr> <tr> <td>RT 101E</td> <td>25 – 90</td> <td>300</td> </tr> <tr> <td>RT 107E</td> <td>70 – 150</td> <td>215</td> </tr> <tr> <td>RT 123E</td> <td>150 – 250</td> <td>300</td> </tr> </tbody> </table>		Type	Range [°C]	Max. permissible bulb temperature [°C]	RT 14E	-5 – 30	150	RT 101E	25 – 90	300	RT 107E	70 – 150	215	RT 123E	150 – 250	300							
Type	Range [°C]	Max. permissible bulb temperature [°C]																							
RT 14E	-5 – 30	150																							
RT 101E	25 – 90	300																							
RT 107E	70 – 150	215																							
RT 123E	150 – 250	300																							
<table border="1"> <thead> <tr> <th>Temperature class</th> <th>Process temperature limit [°C]</th> </tr> </thead> <tbody> <tr> <td>T1</td> <td>300</td> </tr> <tr> <td>T2</td> <td>289</td> </tr> <tr> <td>T3</td> <td>194</td> </tr> <tr> <td>T4</td> <td>129</td> </tr> <tr> <td>T5</td> <td>94</td> </tr> <tr> <td>T6</td> <td>79</td> </tr> </tbody> </table>		Temperature class	Process temperature limit [°C]	T1	300	T2	289	T3	194	T4	129	T5	94	T6	79	<table border="1"> <tbody> <tr> <td>Permissible ambient temperature</td> <td>-20 – 65°C</td> </tr> <tr> <td>Intrinsically safe specification</td> <td> $U_i = 29\text{ V}$ $I_i = 0.5\text{ A}$ $P_i = 1\text{ W}$ $C_i = 0.5\text{ nF}$ $L_i = 0.2\text{ μH}$ </td> </tr> <tr> <td rowspan="3">Contact load</td> <td>max. 100 mA, 30 V a.c. / d.c.</td> </tr> <tr> <td>min. 1 mA, 5 V a.c. / d.c.</td> </tr> <tr> <td>Must be used with a certified Ex ia barrier satisfying the input parameters.</td> </tr> </tbody> </table>		Permissible ambient temperature	-20 – 65°C	Intrinsically safe specification	$U_i = 29\text{ V}$ $I_i = 0.5\text{ A}$ $P_i = 1\text{ W}$ $C_i = 0.5\text{ nF}$ $L_i = 0.2\text{ μH}$	Contact load	max. 100 mA, 30 V a.c. / d.c.	min. 1 mA, 5 V a.c. / d.c.	Must be used with a certified Ex ia barrier satisfying the input parameters.
Temperature class	Process temperature limit [°C]																								
T1	300																								
T2	289																								
T3	194																								
T4	129																								
T5	94																								
T6	79																								
Permissible ambient temperature	-20 – 65°C																								
Intrinsically safe specification	$U_i = 29\text{ V}$ $I_i = 0.5\text{ A}$ $P_i = 1\text{ W}$ $C_i = 0.5\text{ nF}$ $L_i = 0.2\text{ μH}$																								
Contact load	max. 100 mA, 30 V a.c. / d.c.																								
	min. 1 mA, 5 V a.c. / d.c.																								
	Must be used with a certified Ex ia barrier satisfying the input parameters.																								

Installation

RT units can be fitted in any position. Use the mounting holes (25). With outdoor installation, the unit should be protected against rainfall. The bulb should be fixed to the wall by means of a bulb holding bracket (26). If it is desired to install the bulb in a water or brine tank, this can be done by using either a capillary stuffing box (31) or a bulb pocket (30). If bulb pocket is to be used, for correct bulb fitting see fig. 3.

Electrical connection

See fig. 4.

START = make. STOP = break. DIFF. = differential.

Cable diameter: 6 – 14 mm

The earth terminal (38) should be connected to earth.

Wire dimension: min. 0,75mm²

Adjustment

Set the thermostat for minimum actuating temperature (range setting).

Setting is done by rotating the knob (5), at the same time reading the main scale (9).

The differential is set by rotating the differential adjusting nut (19) according to the nomogram concerned (fig. 2).

Maximum actuating temperature is the sum of the temperature setting and the differential.

Example:

An RT 123E is required to regulate the temperature in a drying oven.

Max. temperature 188 °C, min. temperature 180 °C, differential

188-180=8 °C.

1. Set the thermostat on 180 °C with the knob (5).
2. Set the differential adjusting nut (19) on number 3 which can be found by reading off the nomogram for the RT 123E in fig. 2.

In general, turning the knob automatically moves both the maximum and minimum actuating temperatures (break and make) up or down because of the fixed differential. On the other hand, turning the differential adjusting nut only, alters the maximum actuating temperature.



Safety requirements

1. The refrigeration system must always comply with European Ex installation standard, EN 60079-14, any local directive and legislation as well as any other regulation applying in the area of

installation.

2. RT-E temperature control must be used only with reliable means of limiting the voltage and current to prevent sparks between the contact surfaces. The equipment to be used for electrical load limiting must be certified for gas group IIC. Also RT-E thermostat must be installed as a part of IIC electrical installation.
3. Cable and cable entries approved for the application must be used. Cables must not be in contact with sharp edges. The cable must be connected with adequate stress relief in order to prevent that pulling forces can be carried through the cable to the terminal.
4. The cycle frequency of the RT-E switch must be kept as low as possible to prevent fatigue failure on the bellows. The vibration level must be kept as low as possible.
5. It is recommended to regularly check the function of the RT-E switch.
6. Only apparatus designed, constructed and released by Danfoss must be used for application concerned. Danfoss can accept no responsibility in case of alterations made on the thermostats or the use of them against the instructions of Danfoss.
7. Any overload of the RT switch must be prevented. Overloaded or damaged apparatus must be exchanged.
8. Only authorised persons, who are certified in installing and maintaining refrigeration system may do the installation, maintenance and exchange of the switch.
9. Use only appropriate tools
10. Dispose of the switch in an environmentally-friendly way.
11. RTE switches must be installed in area where is low risk of mechanical damage.
12. Components within the equipment can exceed the enclosure temperature by 1K (1°C). When the media temperature exceeds 80°C, it is the responsibility of the user to ensure that the media temperature does not cause a thermal ignition risk on parts between the media and the switch enclosure. Maximum media temperature on temperature switch with 2m capillary tube is 300°C.
13. Isolation of the intrinsically safe circuit to ground and to the contact mounting screw has been verified through 500VACrms dielectric strength testing, carried out in accordance with IEC 60079-11:2011 section 10.3.
14. Surface of the front cover is sputtered with stainless steel - avoid abrasion.